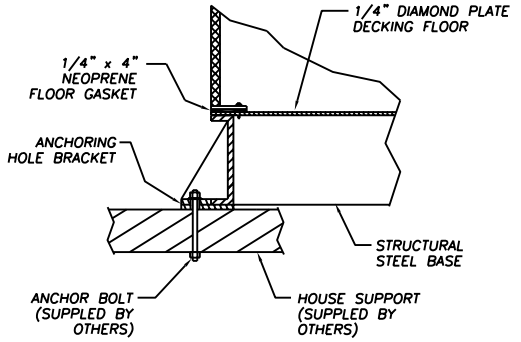

HOUSE ANCHORING DETAIL

THIS DETAIL IS FOR REFERENCE ONLY, CONSULT LOCAL CODES FOR FINAL CONSTRUCTION.

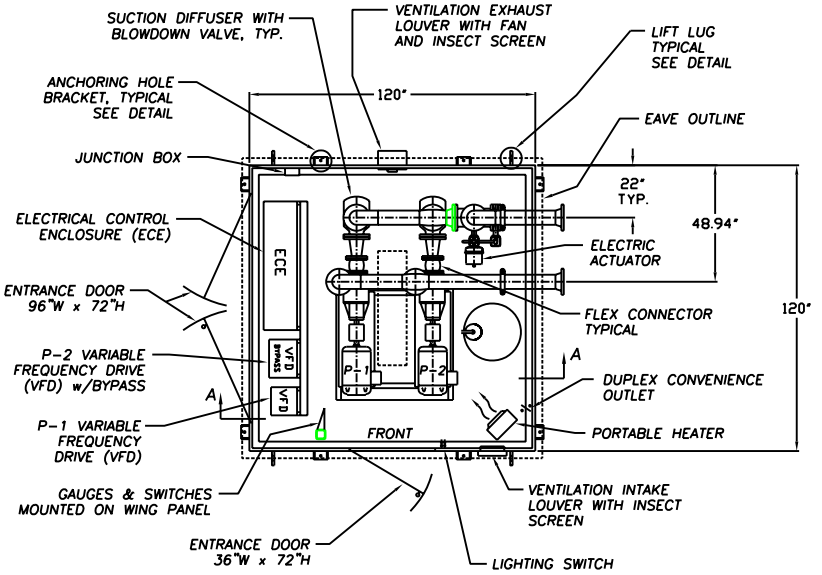

IMPORTANT

1. NOTICE: PIPING DIMENSIONS ARE APPROXIMATE. FINAL DIMENSIONS MAY VARY DUE TO MANUFACTURING TOLERANCES. DO NOT COMPLETE FIELD PIPING UNTIL SYSTEM IS PROPERLY INSTALLED. SYSTECON ACCEPTS NO LIABILITY DUE TO DIMENSION VARIANCES.
2. DO NOT RIG FROM SYSTEM PIPING.
3. LEVEL AND SHIM BASE BEFORE ANCHORING.
4. DO NOT BIND SYSTEM CONNECTIONS.
5. FIELD PIPING MUST BE SUPPORTED INDEPENDENT OF SYSTEM CONNECTIONS.
6. ALLOW 48" CLEARANCE IN FRONT OF ELECTRICAL ENCLOSURES

ETL THIS SYSTECON PACKAGED SYSTEM COMPLIES WITH ANSI/UL-778 AND UL-508 AND BEARS THE ETL LABEL OF CERTIFICATION.

_125_ PSIG MAXIMUM SUCTION DESIGN.
_175_ PSIG MAXIMUM DISCHARGE DESIGN.
PUMPING SYSTEM TYPE: _PSP112_
SYSTEM FLOW: _550_ GPM; _63_ PSIG
USE: _PROCESS CHILLED WATER_

PUMP	MODEL	FLOW	HEAD	HP
P-1	LF-3012-1	550	100	25
P-2	LF-3012-1	550	100	25

POWER: _460_ V. _3_ PH. _60_ HZ.

SYSTEM WEIGHT: SHIPPING Wt.= 10,125 Lb.

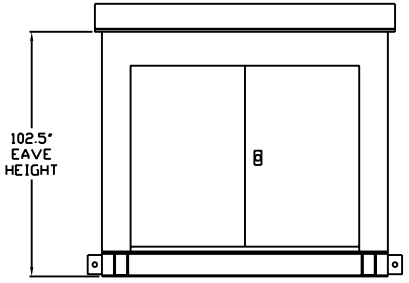

LEFT SIDE VIEW

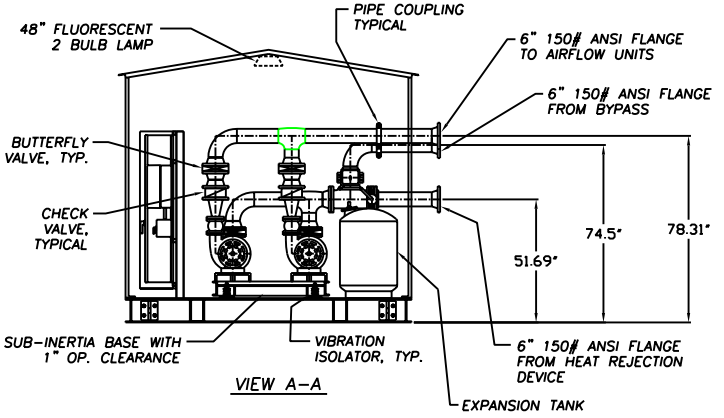

VIEW A-A

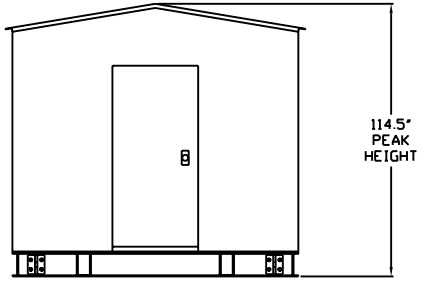

FRONT VIEW

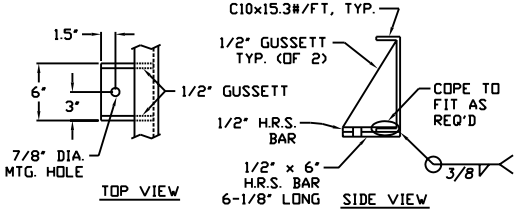

ANCHORING HOLE DETAIL

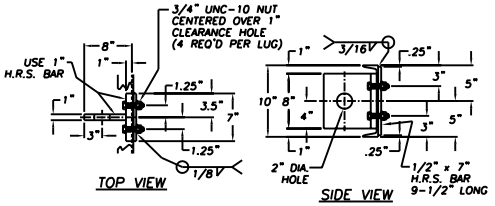

LIFT LUG DETAIL

THE INFORMATION INCLUDED HEREIN IS OWNED BY SYSTECON® INC. THIS INFORMATION IS PRESENTED SOLELY TO AID IN THE APPLICATION OF SYSTECON® PRODUCTS AND MAY NOT BE USED FOR ANY OTHER PURPOSE WITHOUT SPECIFIC WRITTEN PERMISSION FROM SYSTECON® INC. FURNISHING OF THIS INFORMATION DOES NOT CONSTITUTE AUTHORIZATION OR LICENSING FOR ANY OTHER USE.

DATE	REVISION	DRN. BY	CHK. BY

DRN.
CHK.
ARCH./ENG.
TITLE MECHANICAL SYSTEM LAYOUT
JOB NAME PACKAGE SIZE "A"
DRAWING NO.
SHT. OF

Systecon®